



B Brugsvandsveksler
 2 Kontraventil
 7 Termisk ventil

11 Brugsvandscirk.pumpe
 18 Termometer

Unit no.:
 99181900
 Unit no.:
 99182000
 Unit no.:
 Unit no.:

OBS.:
 Føleren fra den mindste ventil
 skal monteres tættest på veksleren.

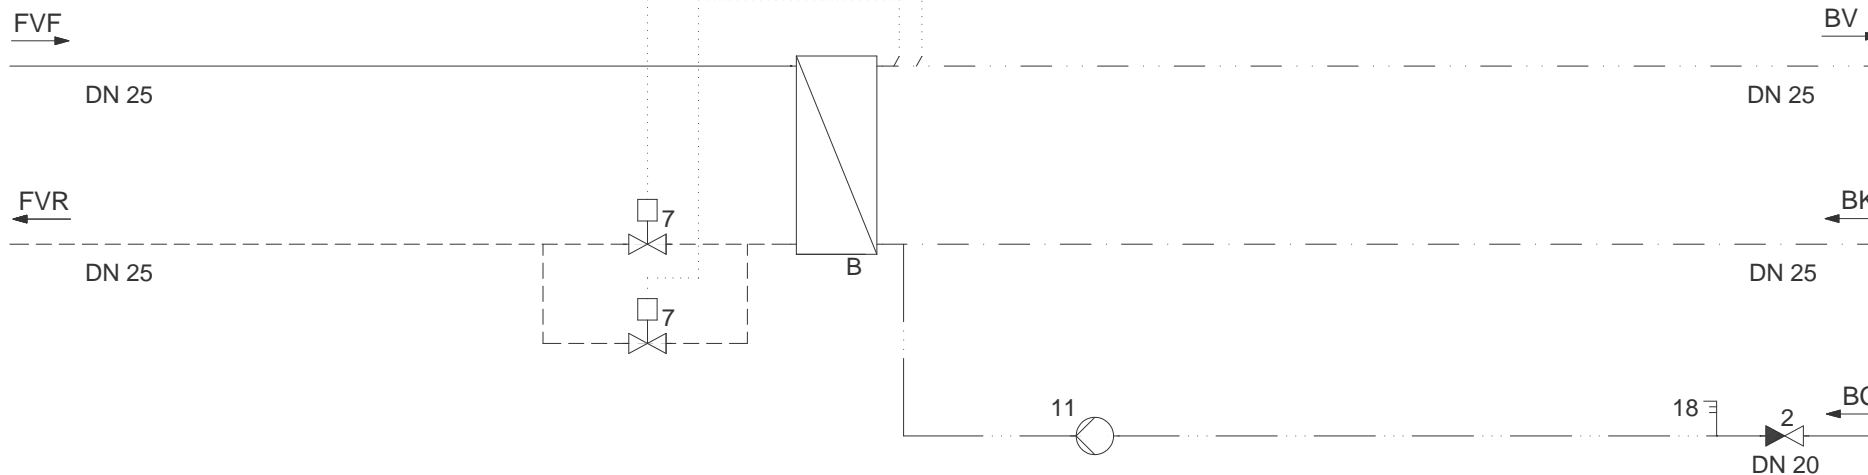

 Gemina • Termix Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk	Contr.:	Date:	Sign:
	JOE 21.06.05	16.03.05	SJJ
Drwg. no.: 99181900			
Title: Termix BV-unit type 4 & 5 T-CP (20T)			
Principdiagram Fjernvarmestation	Rev:	Date:	Sign.: