



B Brugsvandsveksler
 2 Kontraventil
 7 Termisk ventil

11 Brugsvandscirk.pumpe
 18 Termometer

Unit no.:
 99182100
 Unit no.:
 99182200
 Unit no.:
 99182300
 Unit no.:

OBS.:
 Føleren fra den mindste ventil
 skal monteres tættest på veksleren.

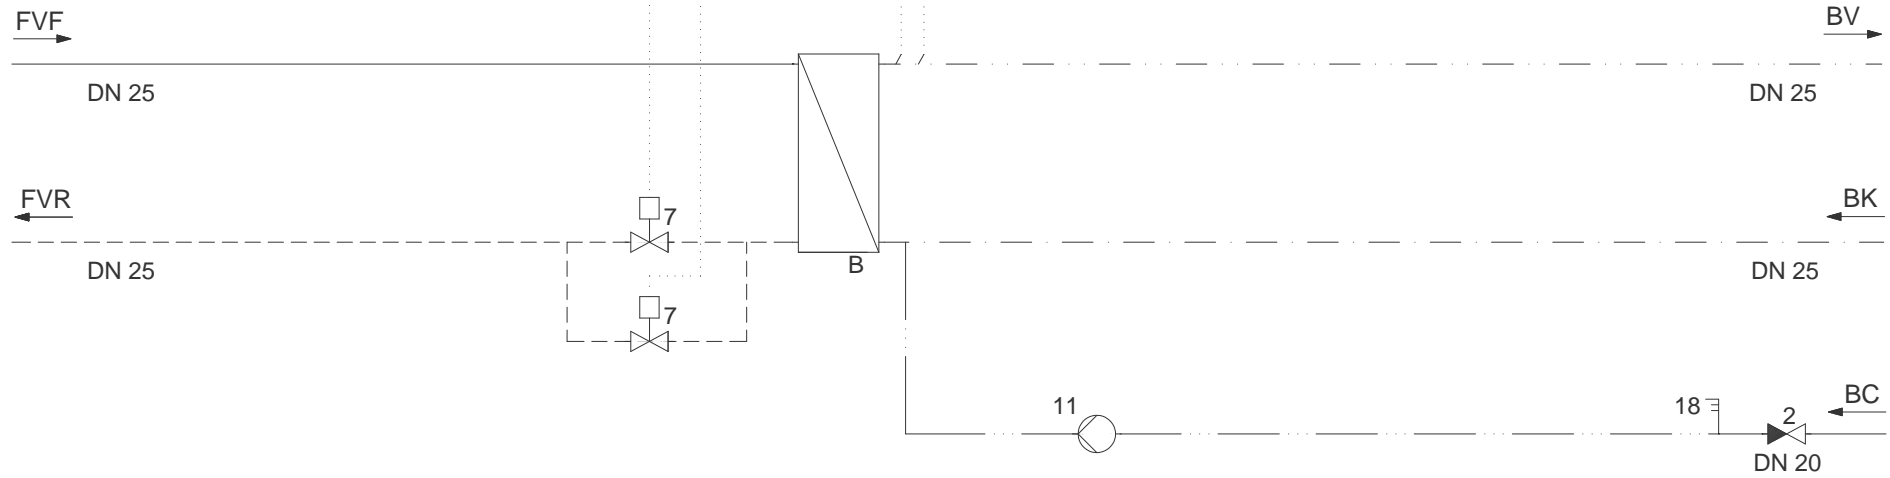

 Gemina • Termix Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk	Contr.:	Date:	Sign:
	JOE 21.06.05	31.03.00	SJJ
Drwg. no.: 99182100			
Title: Termix BV-unit type 6 - 8 T-CP (28T)			
Principdiagram			
Fjernvarmestation			
	Rev:	Date:	Sign.: