



SAP no.:	Unit no.:	Foto
	99474321	A
SAP no.:	Unit no.:	Foto
	99474322	B

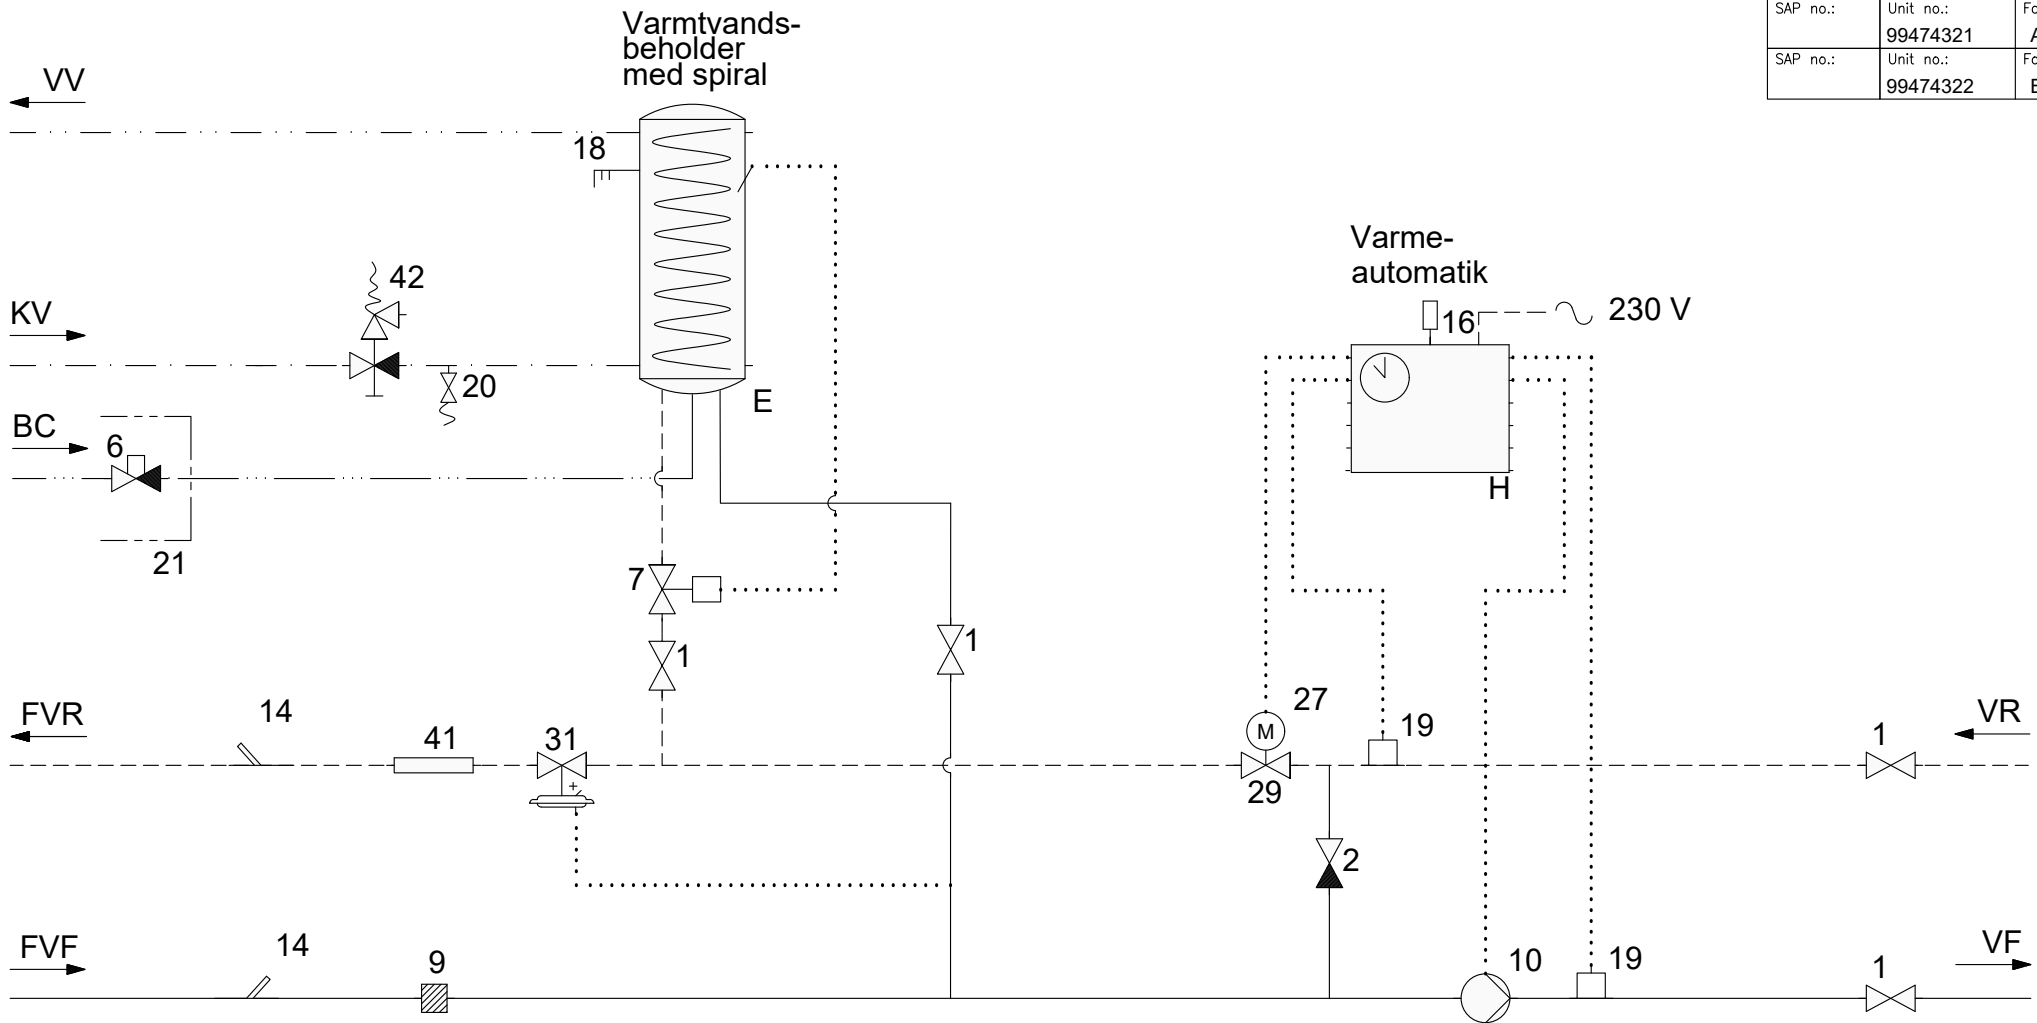

- | | | |
|-----------------------------|-------------------------------|-------------------------------|
| 1 Afspærringsventil | 14 Følerlomme enkelt | 27 Motor |
| 2 Kontraventil | 16 Udeføler | 29 Motorventil |
| 6 Reguleringsvent.m.kontra. | 18 Termometer | 31 Differenstrykregulator |
| 7 Termisk ventil | 19 Påspændingsføler | 41 Målerpasstykke |
| 9 Snavssamler | 20 Aftapnings/påfyldn. ventil | 42 Sikk.agg. m/indb. kontrav. |
| 10 Varmecirkulationspumpe | 21 Bestilles separat | |

 Gemina • Termix Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk	Contr.:	Date:	Sign.:
	LVC 20210209	20170921	KM
Drwg. no.:		99474321	
Title:			
Termix BTD opbl. RTV ISO			
Målerpasstykke i retur			
Principdiagram			
Fjernvarmestation			
Rev:	Date:	Sign.:	